


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-180401-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 3/26/18
IV. END DATE: 4/1/18

V. KEY METRICS:
 Cogen Production: 253,419,251 kWh
 % of Gross Load Served: 87.9%
 Net Grid After All Generation: 34,989 kWh
 Net Exports: 16,366 kWh
 Cogen Run-hours: 161.25 run-hours

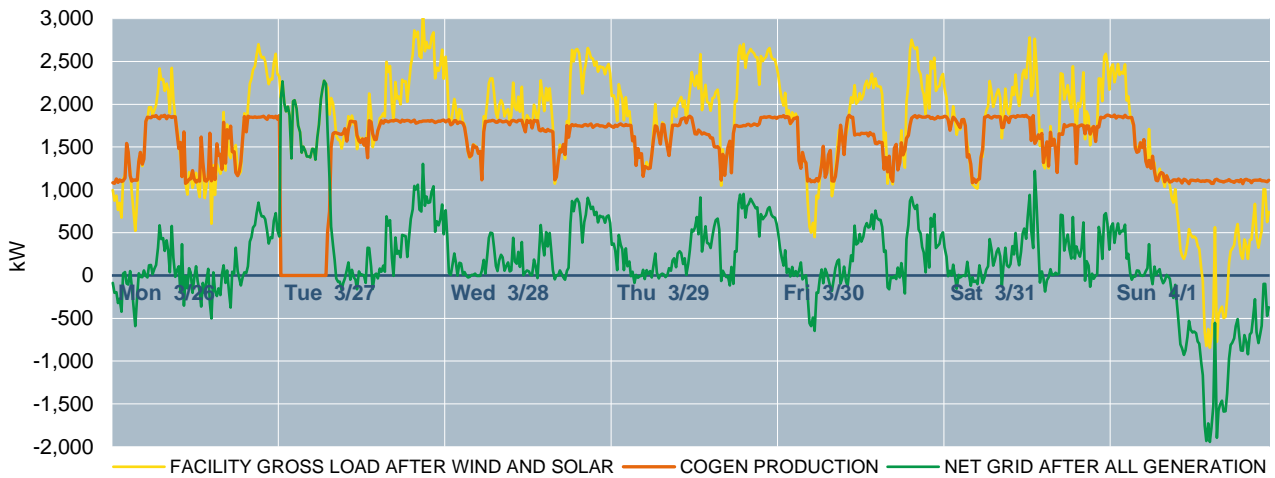

III. UNPLANNED OUTAGES: One: Tripped on 3/27 because of knock sensor required shutdown. Downtime 6.5 hours.

IV. OPERATING NOTES:

1. Cogen ran in load follow mode for the week
2. Cogen tripped at midnight, was brought back up at 6:30am
3. Chiller module commissioning in progress
4. Mechanical commissioning in progress
5. Genset clipped at 1850 kW until mechanical commissioning complete, knock sensor issue was not resolved during planned maintenance

V. UPCOMING: Completion of mechanical commissioning