


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-180520-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 5/14/18
IV. END DATE: 5/20/18

V. KEY METRICS:
 Cogen Production: 306,882 kWh
 % of Gross Load Served: 104.6%
 Net Grid After All Generation: -13,506 kWh
 Net Exports: 58,769 kWh
 Cogen Run-hours: 166.5 run-hours

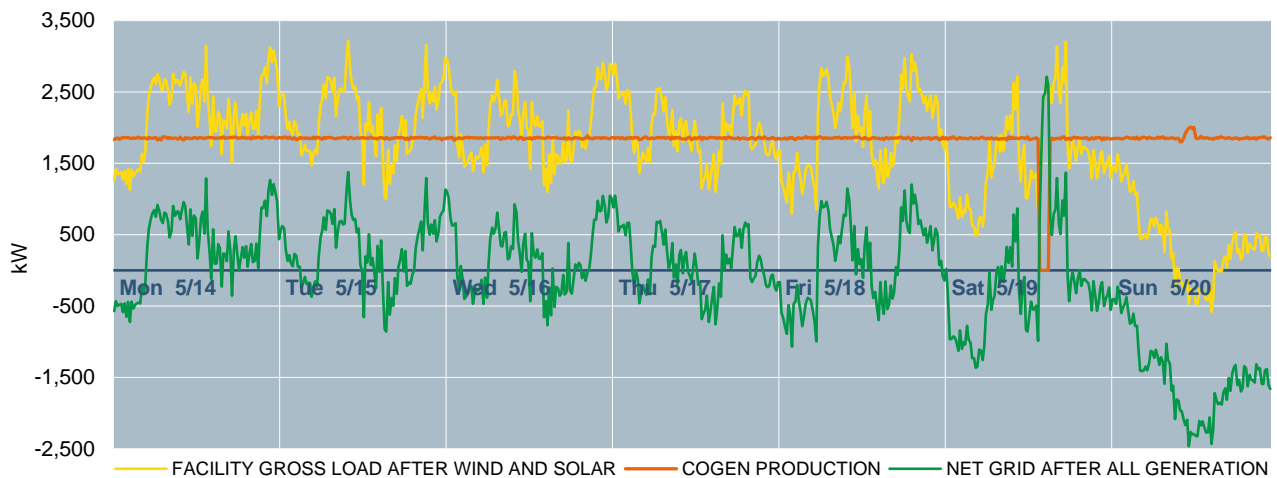

- III. UNPLANNED OUTAGES:**
1. Tripped on Saturday, May 19 at 1:30 p.m. on overcurrent; down for 1 hour 15 minutes (1:15); cause is believed to be grid sagging
- IV. OPERATING NOTES:**
1. Cogen ran at 1850 kW for the week
 2. Load test on Sunday, May 20 for 1 hour at 1988 kW completed without incident
 3. Chiller module commissioning in progress: modifications made over previous weeks were tested; ammonia was chilled to 24°F
- V. UPCOMING:**
1. Chiller commissioning
 2. Meeting this week with Advance Water Eng. for water treatment solution