


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-180624-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 6/18/18
IV. END DATE: 6/24/18

V. KEY METRICS:
 Cogen Production: 174,966 kWh
 % of Gross Load Served: 49.0%
 Net Grid After All Generation: 181,818 kWh
 Net Exports: 13,505 kWh
 Cogen Run-hours: 129.75 run-hours

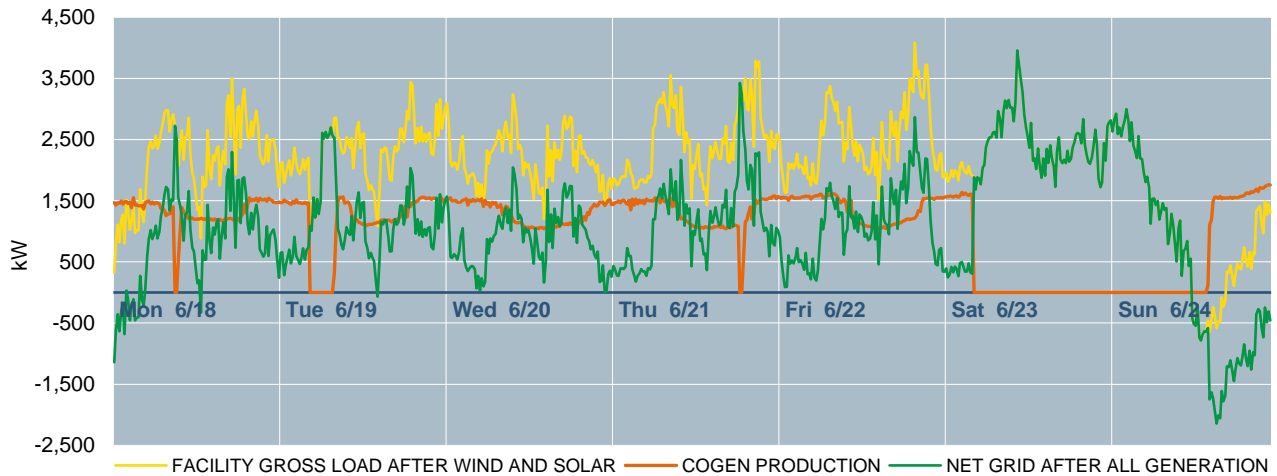

- III. UNPLANNED OUTAGES:**
- Monday at 8:46 a.m. due to grid instability; downtime: 38 minutes. The cause seems to be an undercurrent from the grid.
 - Tuesday at 4:26 a.m. related to grid issue with PG&E. We expect to see 7000 kV coming from the grid and at the time of trip it dropped to 3000 kV; downtime: 3:29.
- IV. OPERATING NOTES:**
- Cogen primary setting at 1850 kW.
 - Week long unscheduled dip in production. Currently working with CAT engineering to diagnose and correct.
 - Brought engine down Thursday and over the weekend to diagnose issues with engine.
 - Chiller module commissioning in progress.
- V. UPCOMING:**
- Chiller commissioning
 - Actively working on solution to remediate tripping caused by grid.