


W E E K L Y O P E R A T I O N S R E P O R T

- I. DOCUMENT ID#:** CPI-OPS-7601-180722-AM1
- II. TITLE:** TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
- III. START DATE:** 7/16/18
- IV. END DATE:** 7/22/18
- V. KEY METRICS:**
 - Cogen Production: 267,024 kWh
 - % of Gross Load Served: 71.3%
 - Net Grid After All Generation: 107,352 kWh
 - Net Exports: 2,596 kWh
 - Cogen Run-hours: 150 run-hours

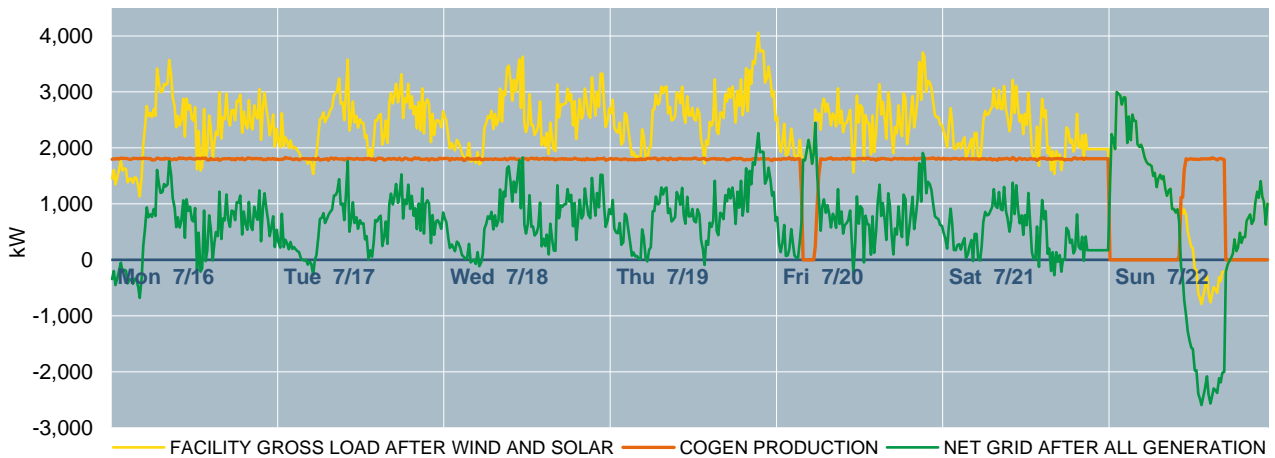

- III. UNPLANNED OUTAGES:**
 1. Saturday at 12:02 a.m. due to grid instability, technician inspected system and brought it system back online; downtime: 10 hours and 11 minutes. The cause seems to be an undercurrent from the grid.
 2. Saturday at 4:58 p.m. due to grid instability, technician inspected system and attempted to bring the system back online, instability continued for several hours; downtime: 7 hours and 2 minutes. System brought back up Monday morning, please see next weeks report for additional information.
- IV. OPERATING NOTES:**
 1. Brought system down Friday morning to inspect cylinders for 1 hour and 49 minutes.
 2. Chiller calibration complete.
- V. UPCOMING:**
 1. Running chiller module.