


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-180729-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 7/23/18
IV. END DATE: 7/29/18

V. KEY METRICS:
 Cogen Production: 269,647 kWh
 % of Gross Load Served: 73.5%
 Net Grid After All Generation: 97,419 kWh
 Net Exports: 24,444 kWh
 Cogen Run-hours: 154.5 run-hours

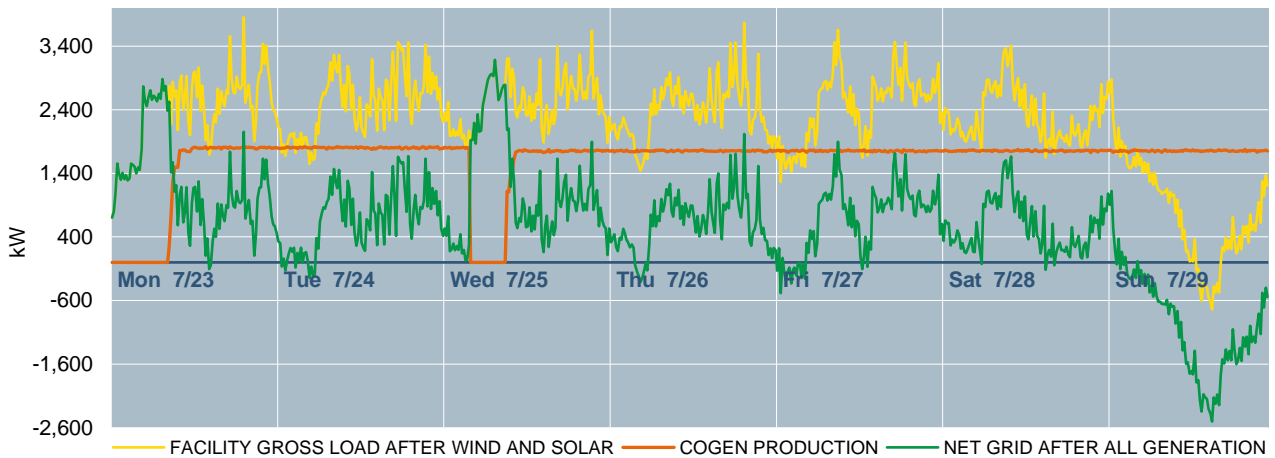

- III. UNPLANNED OUTAGES:**
- Continuing from previous Sunday (7/22) through Monday morning. System tripped due to grid instability; technician inspected system but was unable to bring the system back online because of the unstable grid. Once the grid stabilized in the morning, the system was brought up; downtime: 8 hours and 19 minutes.
- IV. OPERATING NOTES:**
- Primary Cogen setting at 1750 kW.
 - Brought system down Wednesday morning to inspect cylinders for 5 hours and 19 minutes.
 - Replaced valves and calibrated sensors at Chiller.
- V. UPCOMING:**
- Attempt to fill Chiller and run in test mode.