


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-181028-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 10/22/18
IV. END DATE: 10/28/18

V. KEY METRICS:
 Cogen Production: 256,900 kWh
 % of Gross Load Served: 62%
 Net Grid After All Generation: 157,227 kWh
 Net Exports: 1,273 kWh
 Cogen Run-hours: 148.25 run-hours

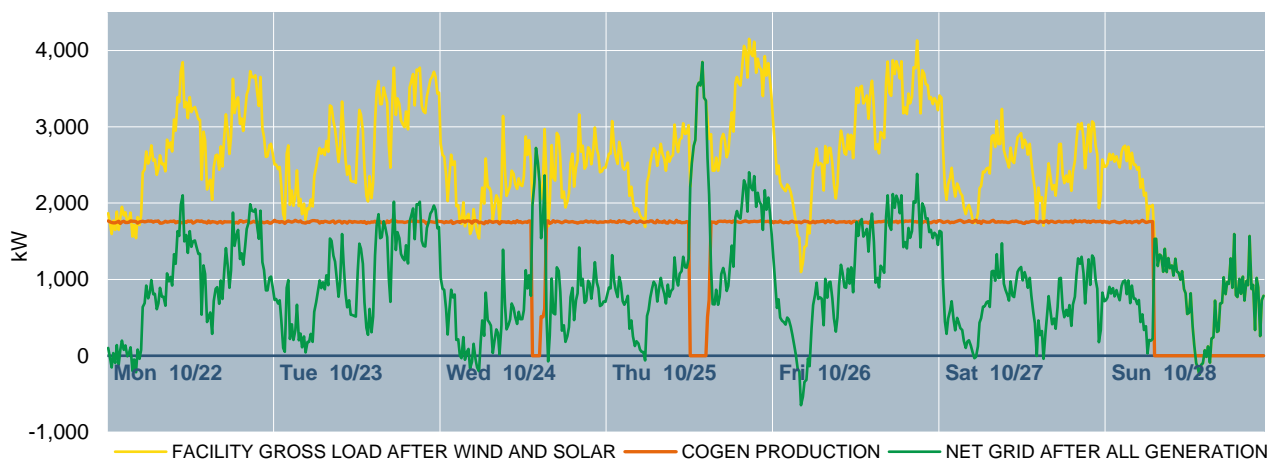

III. UNPLANNED OUTAGES:

1. Wednesday at 1:26 p.m. due to utility grid failure. Downtime: 1 hour and 7 minutes. Technician brought system online after inspection.
2. Thursday 12:06 p.m. due to utility grid failure. Downtime: 2 hours and 36 minutes. Technician brought system online after inspection.
3. Sunday at 7:02 a.m. due to grid instability. Taylor’s limited operation allowed system to stay offline until Monday morning.

IV. OPERATING NOTES:

1. Cogen programed to run at 1750 kW, with load following, for the week.

V. UPCOMING:

1. Work will continue on refrigeration unit to fully commission.