


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-181111-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 11/5/18
IV. END DATE: 11/11/18

V. KEY METRICS:
 Cogen Production: 284,189 kWh
 % of Gross Load Served: --.--%
 Net Grid After All Generation: --- kWh
 Net Exports: --- kWh
 Cogen Run-hours: 158.75 run-hours

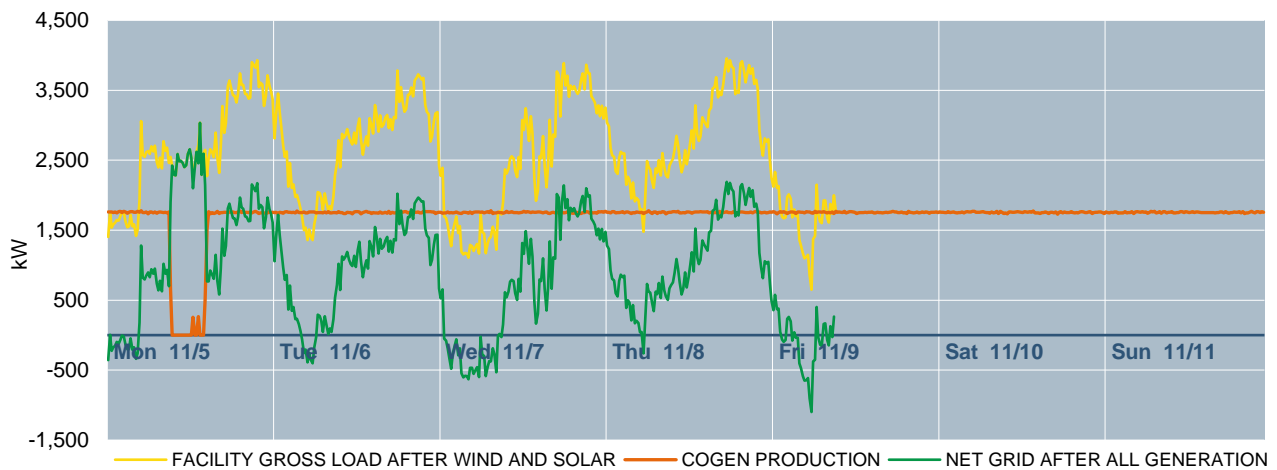

- III. UNPLANNED OUTAGES:**
- Monday 9:19 a.m. due to engine battery issues. Downtime: 4 hours and 51 minutes. Caterpillar Technicians corrected the battery issue and corrected the Turbo temperature communications issue from the previous week. Brought the system online after work was completed.
- IV. OPERATING NOTES:**
- Cogen programed to run at 1750 kW for the week along with load follow logic.
 - On Friday at 9:00 a.m., communications with the revenue meter was interrupted. This issue did not impact the engine’s ability to run, however the HMI was unable to collect data on Taylor’s energy usage during this time.
- V. UPCOMING:**
- Work will continue on refrigeration unit to fully commission.