


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-181125-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 11/19/18
IV. END DATE: 11/25/18

V. KEY METRICS:
 Cogen Production: 115,397 kWh
 % of Gross Load Served: --.--%
 Net Grid After All Generation: --- kWh
 Net Exports: --- kWh
 Cogen Run-hours: 65.75 run-hours

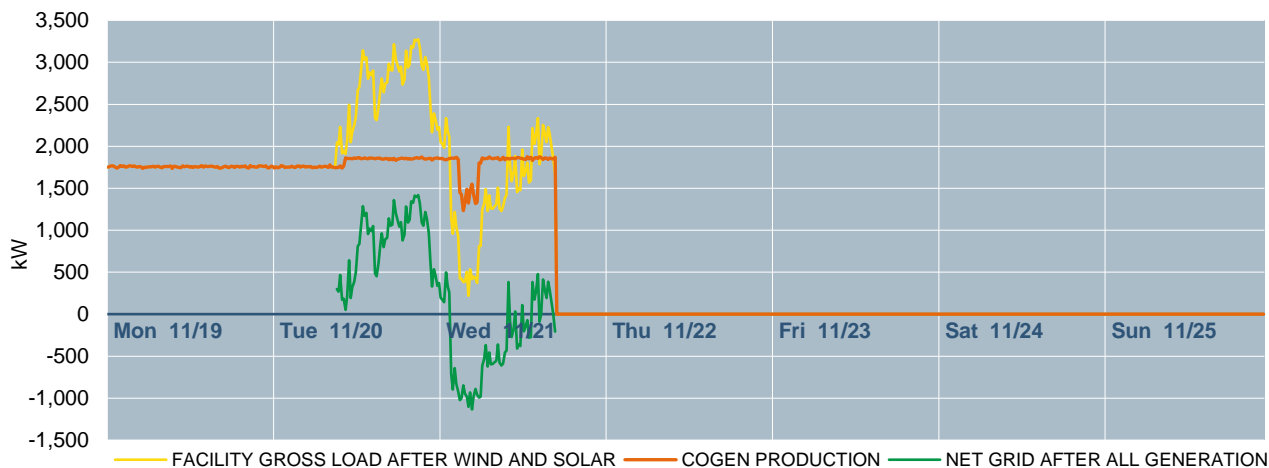

III. UNPLANNED OUTAGES: 1. Wednesday 4:57 p.m. The primary Taylor breaker, F1, was opened which in turn caused the cogen to trip. Downtime 103 hours and 3 minutes.

IV. OPERATING NOTES:

1. Cogen programed to run at 1750 kW on Monday and part of Tuesday. Programed to run at 1850 kW Tuesday and Wednesday along with load follow logic.
2. Communications with the revenue meter was restored on Tuesday morning.
3. All communications with the system were lost on Wednesday when the system tripped. This issue was resolved as of Monday 11/26. Further details in next week’s report.

V. UPCOMING: 1.