


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-181202-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 11/26/18
IV. END DATE: 12/2/18

V. KEY METRICS:
 Cogen Production: 82,362 kWh
 % of Gross Load Served: --.--%
 Net Grid After All Generation: --- kWh
 Net Exports: --- kWh
 Cogen Run-hours: 46 run-hours

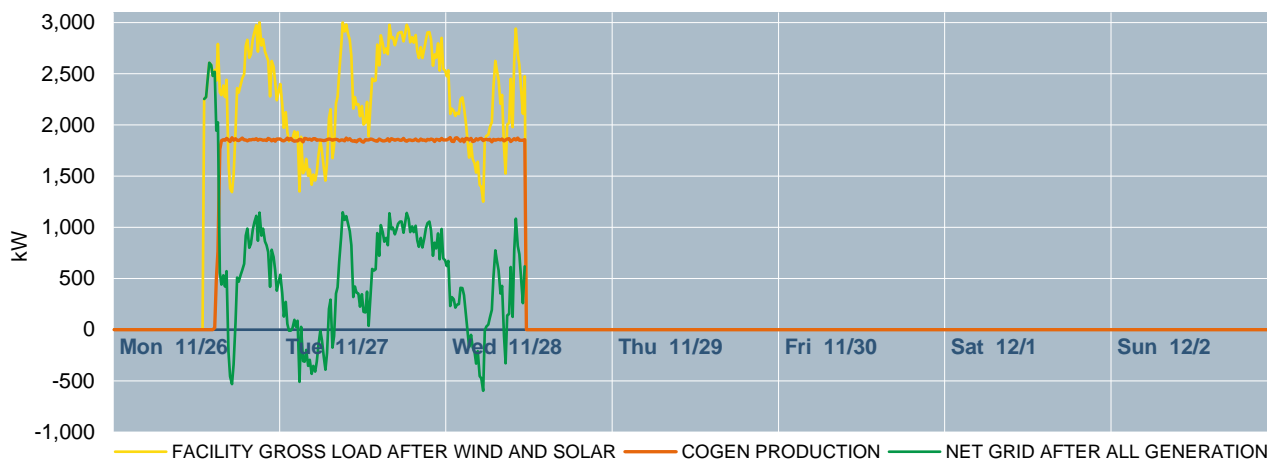

VI. UNPLANNED OUTAGES:

- Continuation from previous week due to site instability and issue with relay. Downtime: 14 hours and 43 minutes. Technician checked the system and brought online.
- Wednesday 11:44 a.m. due to relay equipment damage. Downtime: 108 hours and 16 minutes. The system was down until replacement could be installed.

VII. OPERATING NOTES:

- Cogen programed to run at 1850 kW along with load follow logic.
- Communications with the revenue meter were not operable during unplanned outages.

VIII. UPCOMING:

- Replace relay equipment.