


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: **CPI-OPS-7601-181209-AM1**
II. TITLE: **TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT**
III. START DATE: **12/3/18**
IV. END DATE: **12/9/18**

V. KEY METRICS:
 Cogen Production: 182,188 kWh
 % of Gross Load Served: --.--%
 Net Grid After All Generation: --- kWh
 Net Exports: --- kWh
 Cogen Run-hours: 102.50 run-hours

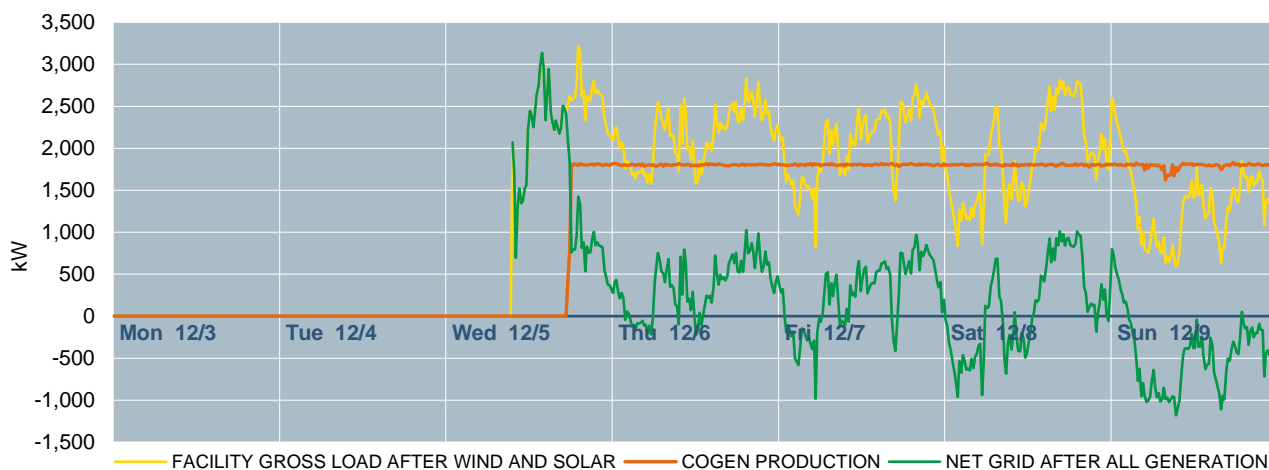

VI. UNPLANNED OUTAGES: 1. Continuation from previous week due to relay damage. Downtime: 65 hours and 37 minutes. Technician replaced damaged relay, checked the system and brought online.

VII. OPERATING NOTES: 1. Cogen programed to run at 1800 kW along with load follow logic.
 2. System ran normally for the remainder of the week.

VIII. UPCOMING: