

Concentric Power Inc. 1550 Dell Ave, Ste I Campbell, CA 95008

150 S. Main St, Ste 130 Salinas, CA 93901 DOC ID#: CPI-OPS-7601-AM1 Issued Date: 1/28/19 Revision: 1.0

WEEKLY OPERATIONS REPORT


- I. DOCUMENT ID#:
- II. TITLE:
- III. START DATE:
- IV. END DATE:

CPI-OPS-7601-190127-AM1 TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT 1/21/19 1/27/19

V. KEY METRICS:

Cogen Production: % of Gross Load Served: Net Grid After All Generation: Net Exports: Cogen Run-hours:

155,098 kWh --.--% ---- kWh ---- kWh 125.75 run-hours

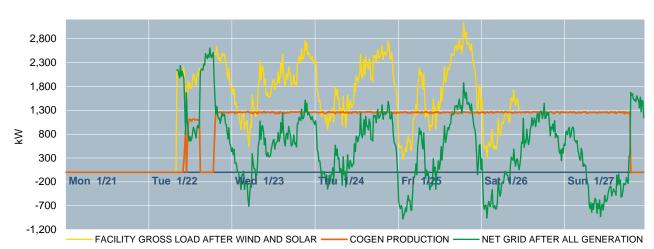

VI. UNPLANNED OUTAGES:

- 1. Continuation from last Sunday due to a wiring harness. Downtime: 35 hours and 1 minute. Technician checked the system and brought system online.
- 2. Tuesday 2:52 p.m. due to wiring harness. Downtime: 3 hours and 57 minutes. Technician checked the system and brought system online.
- 3. Sunday 7:12 p.m. due to wiring harness. Downtime: 4 hours and 48 minutes. The engine was inspected on Monday morning and brought online.

VII. OPERATING NOTES:

- 1. Cogen programed to run at 1300 kW along with load follow logic. The lower kW setting is related to the harness issues.
- 2. The revenue meter was lost last week and was reset when the system was brought back online on Tuesday.

VIII. UPCOMING:

- 1. Continue with M700 commissioning.
- 2. Harnesses scheduled to be replaced in February.