


# W E E K L Y O P E R A T I O N S R E P O R T

**I. DOCUMENT ID#:** CPI-OPS-7601-190722-AM1  
**II. TITLE:** TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT  
**III. START DATE:** 7/22/19  
**IV. END DATE:** 7/28/19

**V. KEY METRICS:**  
 Cogen Production: 295,325 kWh  
 % of Gross Load Served: 81.2%  
 Net Grid After All Generation: 68,485 kWh  
 Net Exports: 20,349 kWh  
 Cogen Run-hours: 168 run-hours

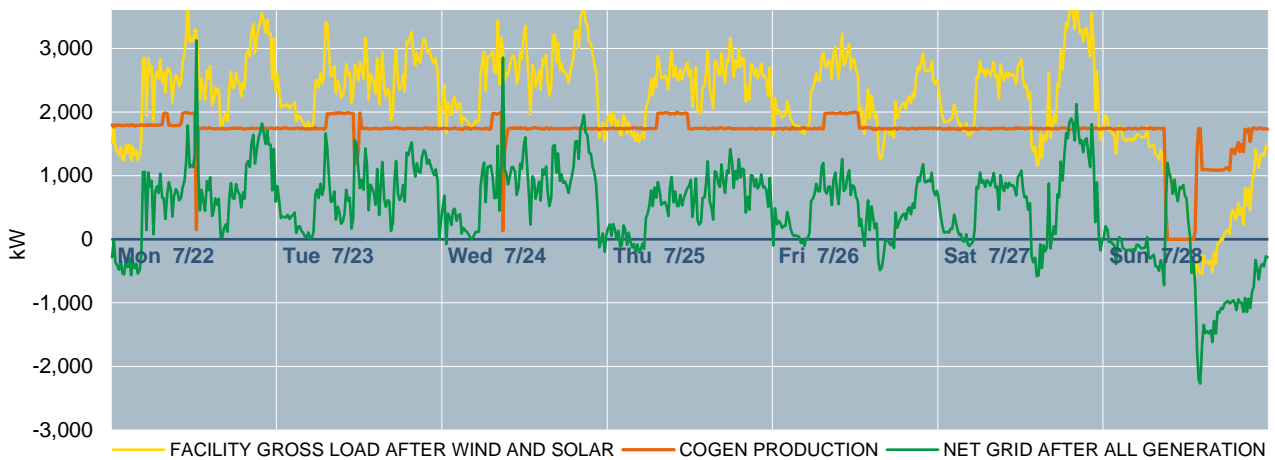

- VI. UNPLANNED OUTAGES:**
1. Monday 12:26 P.M. Grid instability caused the genset to go offline. Downtime: 2 minutes.
  2. Tuesday 11:19 A.M. Grid instability caused the genset to go offline. Downtime: 2 minutes.
  3. Wednesday 8:53 A.M. Grid instability caused the genset to go offline. Downtime: 5 minutes.
  4. Sunday 9:16 A.M. Preparation for upcoming engine service and other preventative maintenance. Downtime: 4 hours, 12 minutes.

**VII. OPERATING NOTES:**

1. Cogen programed to run at 1800 kW with load following.

**VIII. UPCOMING:**

1. 4,000-hour engine service tentatively scheduled for August 4.