




# W E E K L Y O P E R A T I O N S R E P O R T

**I. DOCUMENT ID#:** CPI-OPS-7601-190729-AM1  
**II. TITLE:** TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT  
**III. START DATE:** 7/29/19  
**IV. END DATE:** 8/04/19

**V. KEY METRICS:**  
Cogen Production: 270,492 kWh  
% of Gross Load Served: 82.4%  
Net Grid After All Generation: 57,924 kWh  
Net Exports: 28,759 kWh  
Cogen Run-hours: 153.5 run-hours

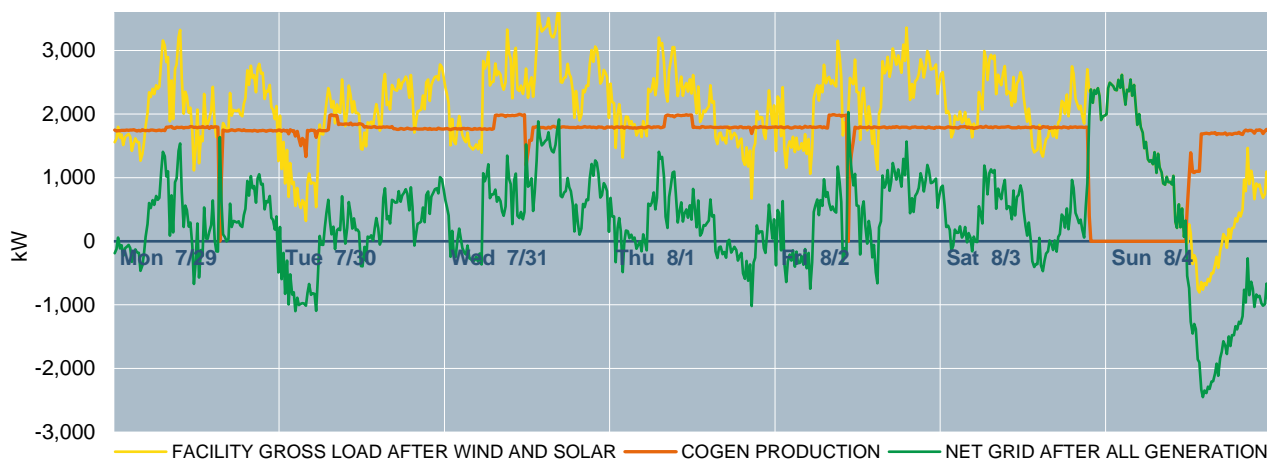

**VI. UNPLANNED OUTAGES:**

1. Monday 3:25 P.M. Accidental breaker trip. Downtime: 12 minutes.
2. Wednesday 11:49 A.M. Grid instability caused the genset to go offline. Downtime: 4 minutes.
3. Thursday 10:41 A.M. Grid instability caused the genset to go offline. Downtime: 12 minutes.

**VII. OPERATING NOTES:**

1. 4,000-hour engine service complete Sunday, required downtime was approximately 14 hours.
2. Cogen programed to run at 1800 kW with load following.

**VIII. UPCOMING:**

1. None.