




# W E E K L Y O P E R A T I O N S R E P O R T

**I. DOCUMENT ID#:** CPI-OPS-7601-190923-AM1  
**II. TITLE:** TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT  
**III. START DATE:** 9/23/19  
**IV. END DATE:** 9/29/19

**V. KEY METRICS:**  
Cogen Production: 247,096 kWh  
% of Gross Load Served: 68.2%  
Net Grid After All Generation: 115,085 kWh  
Net Exports: 12,277 kWh  
Cogen Run-hours: 152.00 run-hours

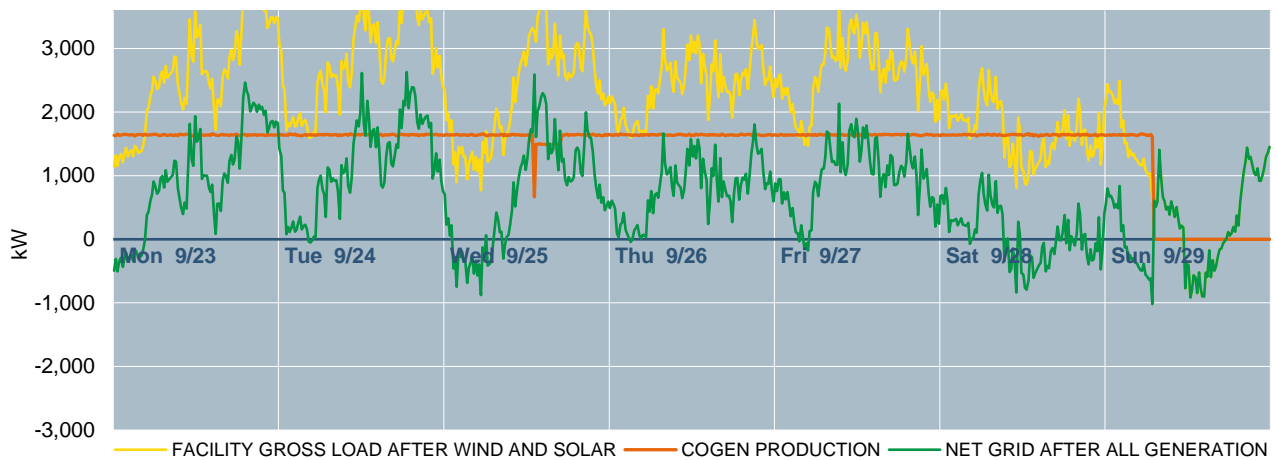

**VI. UNPLANNED OUTAGES:** 1. None.

**VII. OPERATING NOTES:**

1. Cogen was taken offline at 7:00 A.M. Sunday for routine, preventative maintenance. During the course of maintenance, a hose for the exhaust loop was found to be leaking and required replacement before the cogen could be restarted. The hose is being replaced in the morning on Monday September 30<sup>th</sup>.
2. Due to high ambient temperatures, cogen programed to run at 1650 kW with load following.

**VIII. UPCOMING:**

1. Exhaust loop hose being replaced on Monday.
2. M700 commissioning is delayed due to maintenance.