


# W E E K L Y   O P E R A T I O N S   R E P O R T

**I. DOCUMENT ID#:**                      **CPI-OPS-7601-190930-AM1**  
**II. TITLE:**                                **TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT**  
**III. START DATE:**                      **9/30/19**  
**IV. END DATE:**                         **10/06/19**

**V. KEY METRICS:**  
 Cogen Production:                      258,378kWh  
 % of Gross Load Served:            76.6%  
 Net Grid After All Generation:      78,776 kWh  
 Net Exports:                             20,955kWh  
 Cogen Run-hours:                      153.75 run-hours

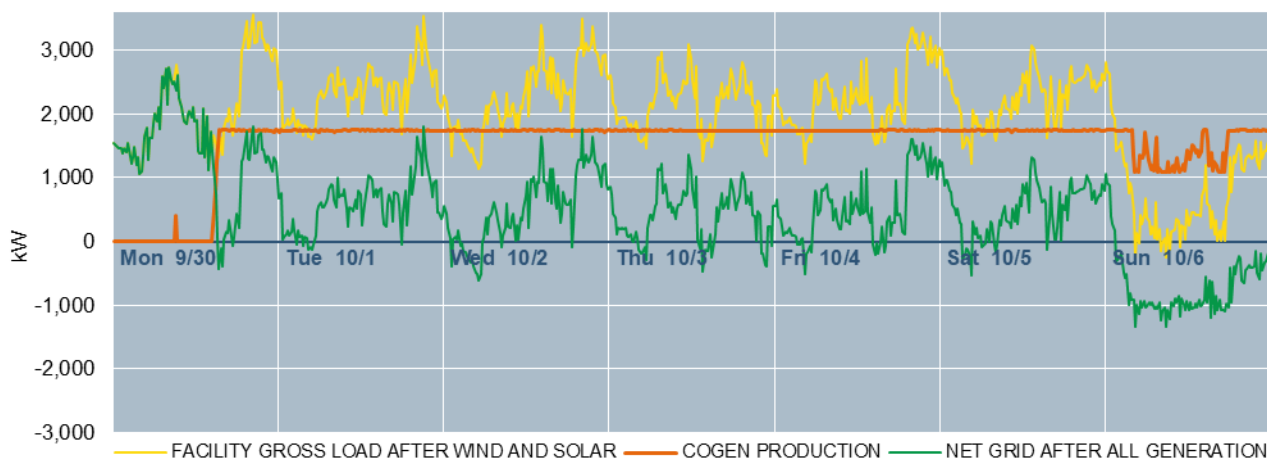

**VI. UNPLANNED OUTAGES:**            1. None.

**VII. OPERATING NOTES:**

1. The exhaust loop hose was replaced and cogen was restarted at 2:29 P.M. on Monday.
2. SCR system went offline on Thursday at 11:21 A.M. due to a faulty solenoid coil. Replacement parts are scheduled for delivery on Tuesday October 8, 2019.
3. Cogen programed to run at 1750 kW with load following.

**VIII. UPCOMING:**

1. SCR solenoid coil will be replaced on Tuesday October 8, 2019.
2. M700 commissioning is delayed due to maintenance.