


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-191104-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 11/04/19
IV. END DATE: 11/10/19

V. KEY METRICS:
 Cogen Production: 196,520 kWh
 % of Gross Load Served: 54.5%
 Net Grid After All Generation: 164,251 kWh
 Net Exports: 22,289 kWh
 Cogen Run-hours: 115.00 run-hours

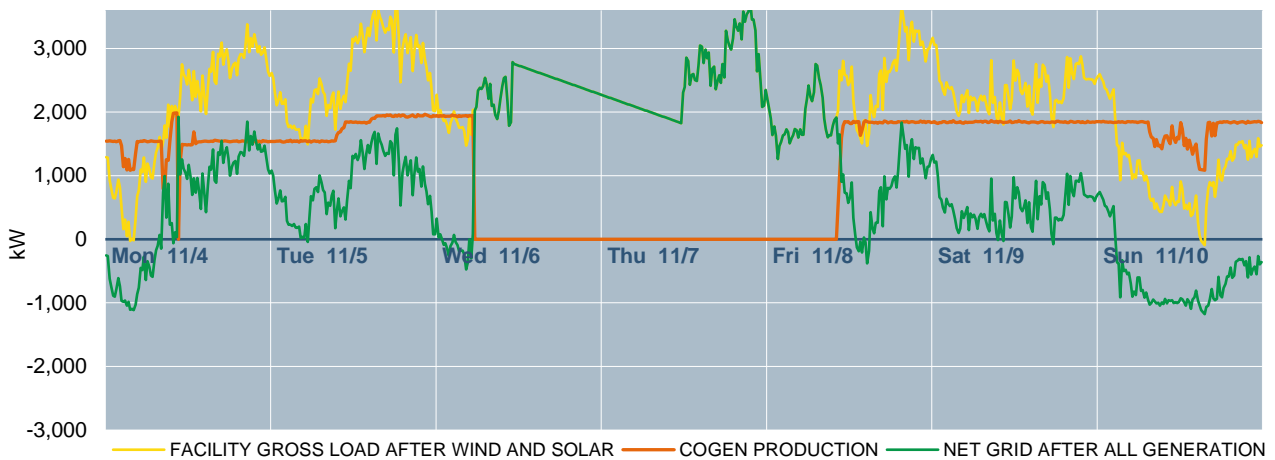

- VI. UNPLANNED OUTAGES:**
1. Genset tripped offline Monday at 10:43 A.M. during update to voltage regulator settings. Downtime: 10 minutes. Voltage regulator found to be cause of previous week’s outages.
 2. Genset taken offline Wednesday at 5:36 A.M. for 2,000-hour scheduled maintenance, during which time a front-end engine oil leak was repaired, and updates to relay settings were addressed. Downtime: 52 hours, 15 minutes.

- VII. OPERATING NOTES:**
1. Facility load data not gathered during relay settings update from Wednesday at 11:36 A.M. to Thursday at 11:21 A.M.
 2. Genset programed to run at 1850 kW with load following.

- VIII. UPCOMING:**
1. M700 commissioning is delayed due to maintenance.