


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-191111-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 11/11/19
IV. END DATE: 11/17/19

V. KEY METRICS:
 Cogen Production: 270,913 kWh
 % of Gross Load Served: 69.1%
 Net Grid After All Generation: 121,329 kWh
 Net Exports: 14,064 kWh
 Cogen Run-hours: 148.75 run-hours

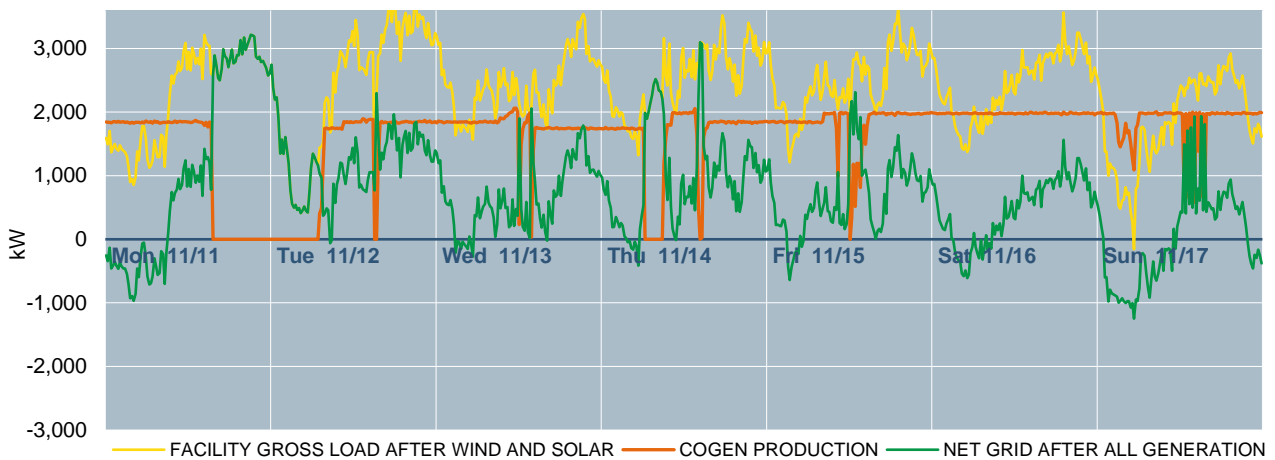

- VI. UNPLANNED OUTAGES:**
1. Genset tripped offline multiple times due to potential voltage regulator issues.
 - Monday 3:36 P.M. Downtime: 15 hours, 27 minutes.
 - Wednesday 12:10 P.M. Downtime: 3 minutes.
 - Wednesday 1:58 P.M. Downtime: 1 minute.
 2. Genset tripped offline Tuesday at 3:08 P.M. due to utility outage. Downtime: 24 minutes.
 3. Genset taken offline Thursday at 6:27 A.M. to replace fan motor. Downtime: 2 hours, 34 minutes.
 4. Genset taken offline several times Thursday and Friday to troubleshoot voltage regulator issues.
 - Thursday 2:16 P.M. Downtime: 28 minutes.
 - Friday 12:14 P.M. Downtime: 1 minute.
 - Friday 12:26 P.M. Downtime: 1 minute.
 - Friday 1:01 P.M. Downtime: 1 minute.

VII. OPERATING NOTES:

1. Genset programed to run at 1850 kW with load following.

VIII. UPCOMING:

1. None.