


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-200120-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 01/20/20
IV. END DATE: 01/26/20

V. KEY METRICS:
 Cogen Production: 263,367 kWh
 % of Gross Load Served: 83.6%
 Net Grid After All Generation: 51,628 kWh
 Net Exports: 20,129 kWh
 Cogen Run-hours: 149.00 run-hours

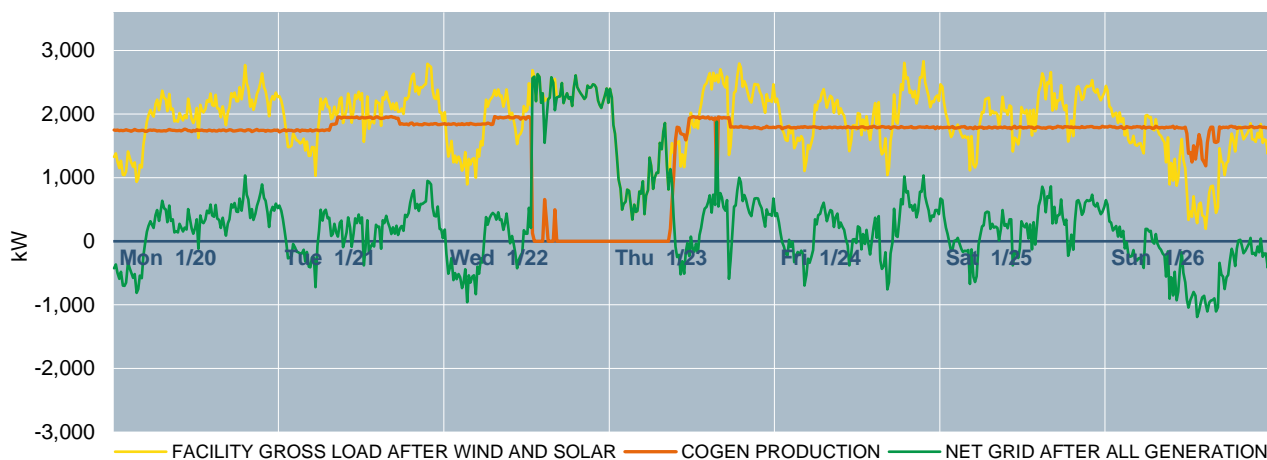

VI. UNPLANNED OUTAGES:

1. Genset was shutdown for maintenance on the coolant loop on Wednesday 1:02 P.M. During the course of maintenance, the coolant loop pump seals failed. Downtime: 19 hours, 54 minutes.
2. Cylinder detonation brought the genset offline on Thursday at 3:31 P.M. Downtime: 6 minutes.

VII. OPERATING NOTES:

1. Genset programed to run at 1750 kW with load following.

VIII. UPCOMING:

1. Coolant loop pump seals will be replaced on Tuesday January 28, 2020.