


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-200330-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 03/30/20
IV. END DATE: 04/05/20

V. KEY METRICS:
 Cogen Production: 129,614 kWh
 % of Gross Load Served: 57.6%
 Net Grid After All Generation: 95,225 kWh
 Net Exports: 37,200 kWh
 Cogen Run-hours: 85.00 run-hours

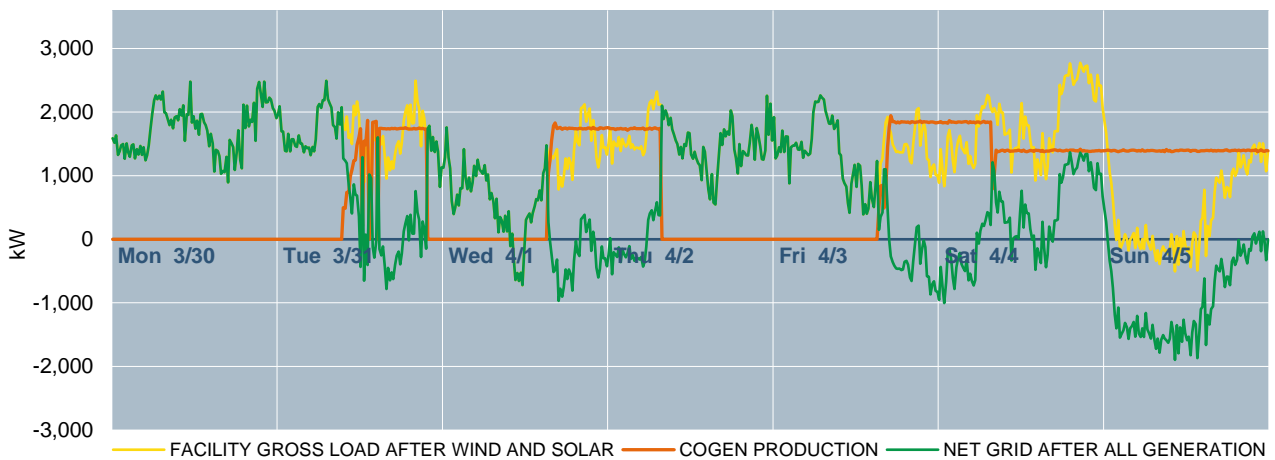

- VI. UNPLANNED OUTAGES:**
1. Repair to genset coolant leak from was completed on Tuesday. Downtime: 463 hours, 4 minutes.
 2. Genset outage due to cylinder detonation on Tuesday at 12:22 P.M. Downtime: 4 minutes.
 3. Genset outage due to cylinder detonation on Tuesday at 1:25 P.M. Downtime: 16 minutes.
 4. Genset outage due to cylinder detonation on Tuesday at 2:42 P.M. Downtime: 8 minutes.
 5. Genset outage due to cylinder detonation on Tuesday at 9:47 P.M. Turbo sensor and NOX sensor replaced. Downtime: 17 hours, 30 minutes.
 6. Genset taken offline Thursday at 7:54 A.M. to repair jacketwater pump oil leak. Downtime: 31 hours, 22 minutes.

VII. OPERATING NOTES:

1. Genset will return to normal, load following operations on April 6, 2020.

VIII. UPCOMING:

1. None.