


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-200823-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 8/17/20
IV. END DATE: 8/23/20

V. KEY METRICS:
 Cogen Production: 221,559 kWh
 % of Gross Load Served: 51.0%
 Net Grid After All Generation: 213,155 kWh
 Net Exports: 1,863 kWh
 Cogen Run-hours: 129.25 run-hours

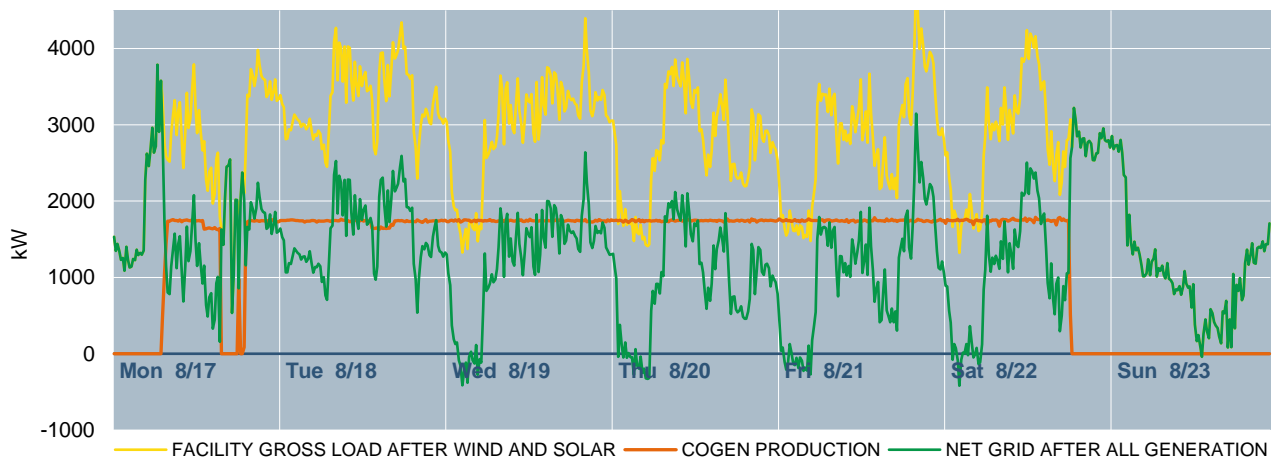

VI. UNPLANNED OUTAGES:

- Monday August 17, we received notice from PG&E of a PSPS due to the heatwave. In anticipation of the outage, we planned to bring the generator offline to prevent sudden trip issues at 3:30PM offline until 6:35PM total down time 3hrs 5minutes.

VII. OPERATING NOTES:

- Genset programmed to run 1750kw in load follow.
- Genset reduced load due to heat on Tuesday 1:15PM-4:20PM at 1650kw setpoint.

VIII. UPCOMING:

- August 26 midnight unit will be brought offline to address a coolant leak at a flex joint in the early morning. We plan to bring the unit back up mid-morning.