


W E E K L Y O P E R A T I O N S R E P O R T

I. DOCUMENT ID#: CPI-OPS-7601-200913-AM1
II. TITLE: TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT
III. START DATE: 9/07/20
IV. END DATE: 9/13/20

V. KEY METRICS:
 Cogen Production: 208,030 kWh
 % of Gross Load Served: 46.9%
 Net Grid After All Generation: 235,105 kWh
 Net Exports: 1,190 kWh
 Cogen Run-hours: 126.25 run-hours

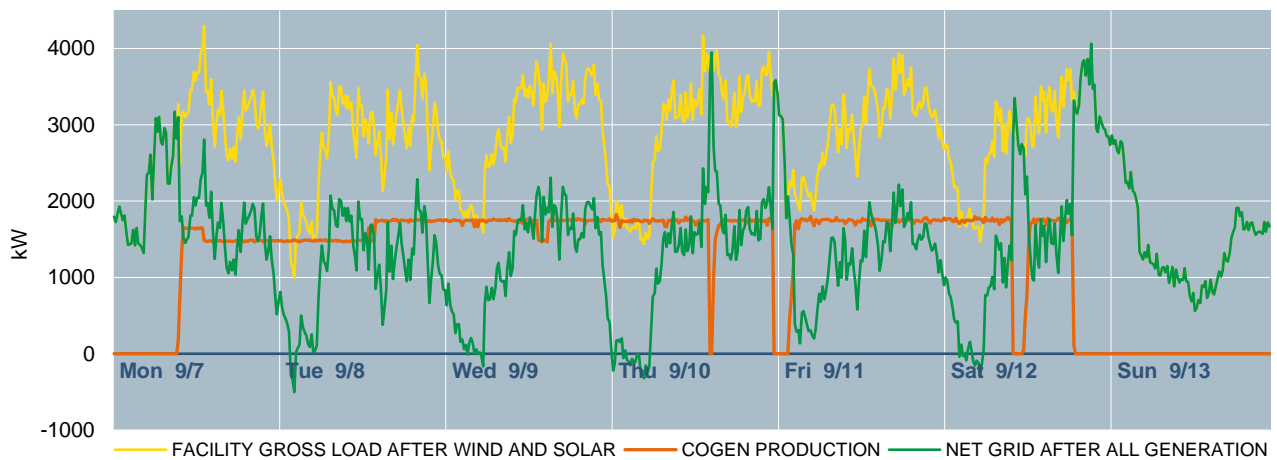

- VI. UNPLANNED OUTAGES:**
- Thursday 9/10 Shutdown due to Cylinder 14 Exhaust temperature differential. 2:00PM - 2:15PM down time 0hrs 15min.
 Cylinder 3 Detonation shut down 11:15PM - 1:15AM Friday 9/11
 Down time 2hrs 0min.
 Saturday 9/12 Cylinder 3 Detonation shut down 9:45AM - 11:00AM
 Down time 1hr 45min.
- VII. OPERATING NOTES:**
- Genset programmed to run 1750kw in load follow.
 9/7 Labor Day start up run at 1450kw to prevent hot temperature issues for the day.
- VIII. UPCOMING:**
- Schedule to be planned for 4k hour engine service 1 weekend This September.