


# W E E K L Y O P E R A T I O N S R E P O R T

**I. DOCUMENT ID#:** CPI-OPS-7601-201227-AM1  
**II. TITLE:** TAYLOR COGEN GONZALES WEEKLY OPERATIONS REPORT  
**III. START DATE:** 12/21/20  
**IV. END DATE:** 12/27/20

**V. KEY METRICS:**  
 Cogen Production: 78,091 kWh  
 % of Gross Load Served: 30.7 %  
 Net Grid After All Generation: 176,529 kWh  
 Net Exports: 2,584 kWh  
 Cogen Run-hours: 48.5 run-hours

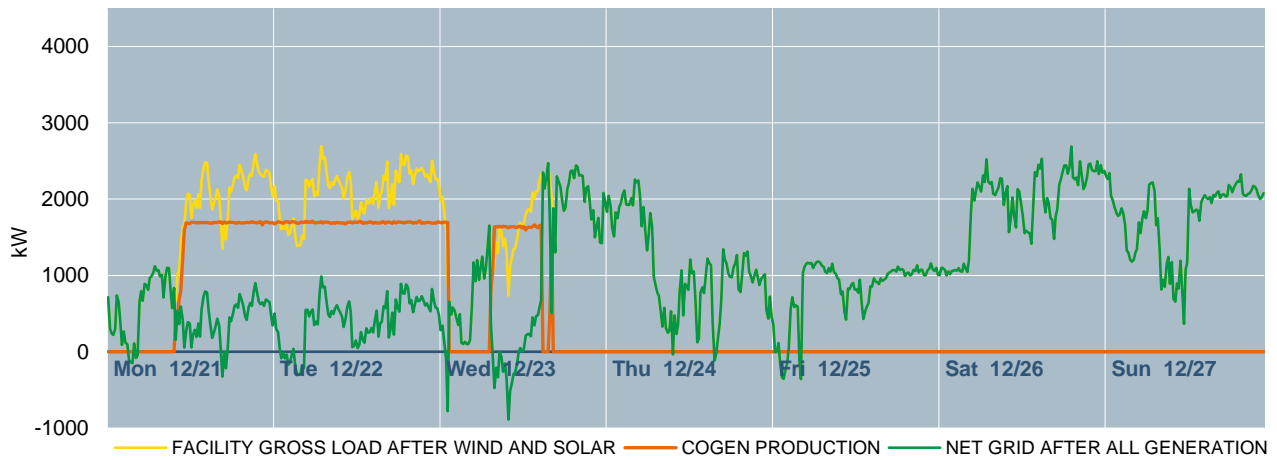

**VI. UNPLANNED OUTAGES:**

1. Wed 23 1:15AM-7:00AM 5hrs 45min Grid dip caused genset to trip.  
 2:45PM-Monday 105hrs Cylinder 6 ignition coil failure, parts held up in shipping.

**VII. OPERATING NOTES:**

1. Genset programmed to run 1700kw-1800kw in load follow. Shut down wed night due to coil failure, parts did not arrive until Monday.

**VIII. UPCOMING:**

1. Monday maintenance prior to start up.